
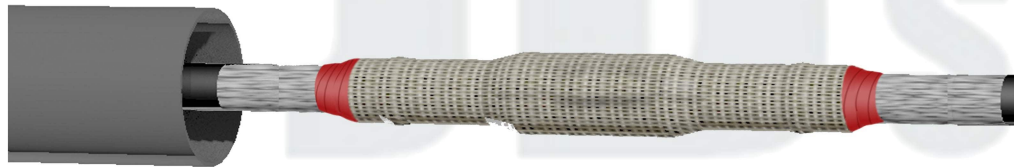


STAGE 5

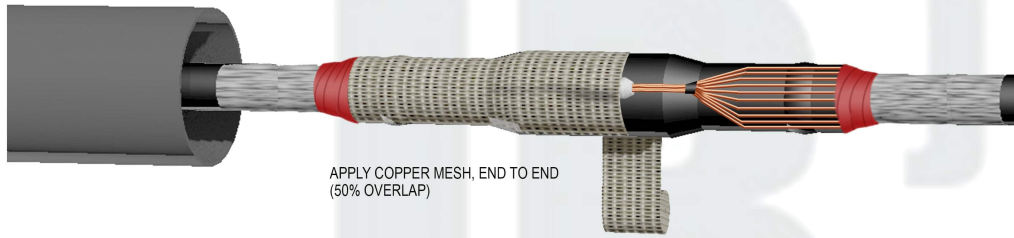

ENERGEX APPROVED
J.Lansley - Date 28.01.2016



6.3 / 11 KV

70 - 300mm² Cu XLPE - XLPE

70 - 400mm² Al XLPE - XLPE


SINGLE CORE - SINGLE CORE STRAIGHT JOINT

STAGE 6

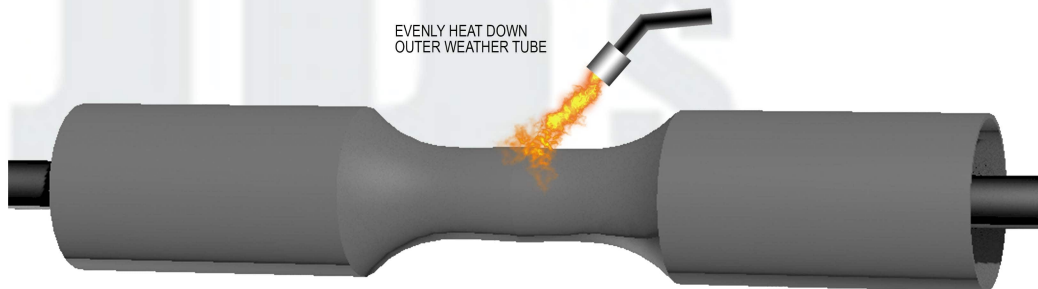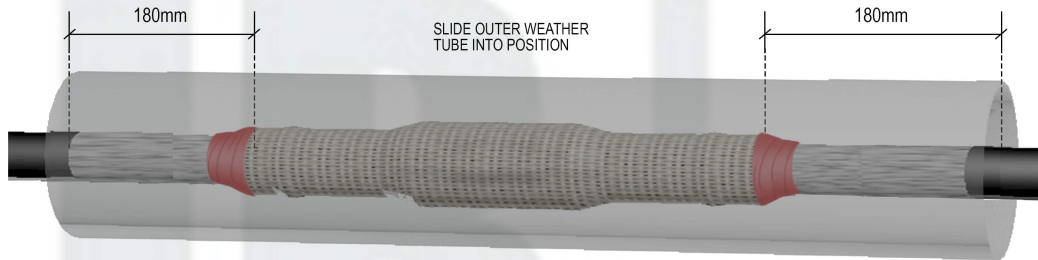


TERMINATION GUIDE



SUMMARY

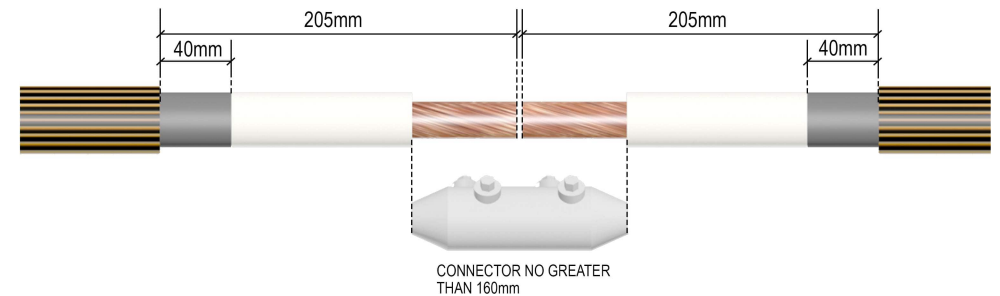


≥ 100mm OVERLAP

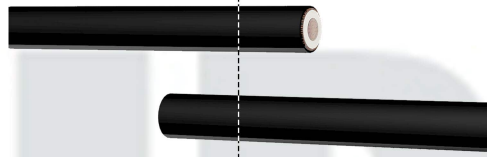



STAGE 1

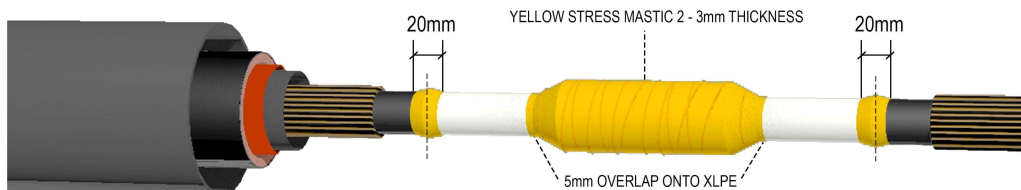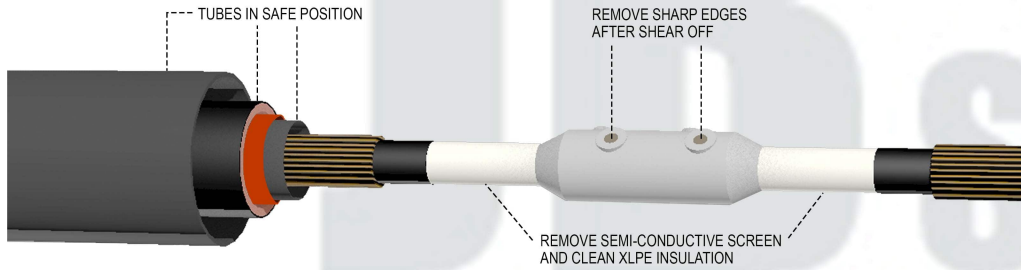

STAGE 2

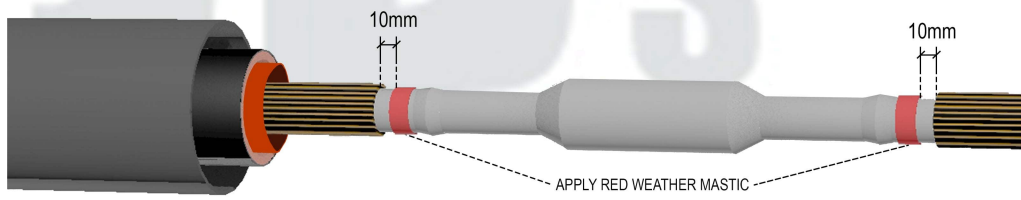

STAGE 3

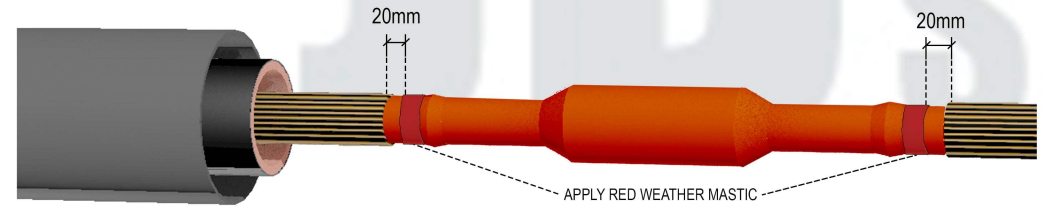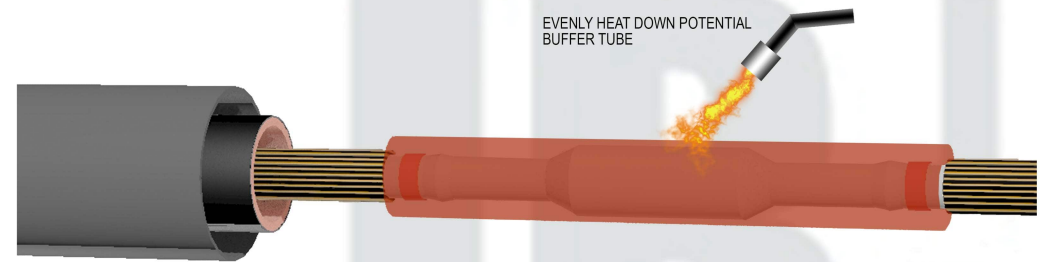

STAGE 4

